




Garden Wall Standard Detail

FOOTING OPTION "A"



FOOTING OPTION "B"

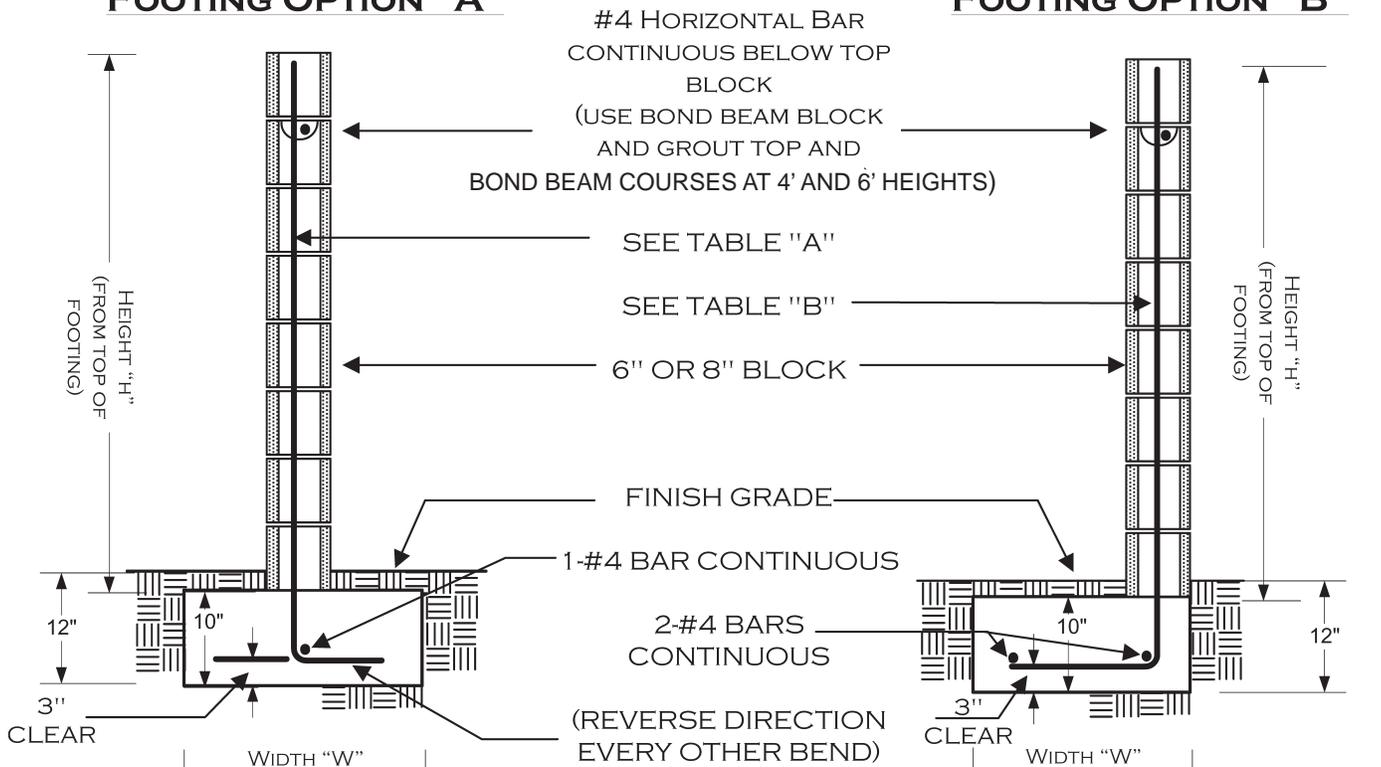

SECTION VIEW

SECTION VIEW

ALL STEEL SHALL BE A MINIMUM OF 3" FROM EARTH

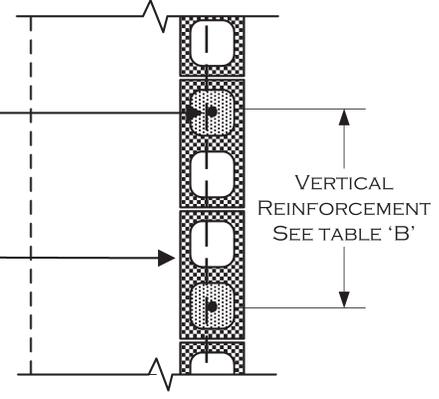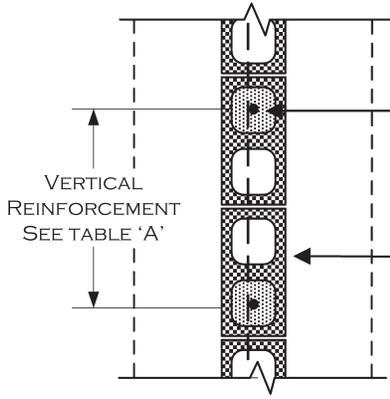

PLAN VIEW

PLAN VIEW

FILL CELLS SOLID WITH GROUT WHERE STEEL OCCURS


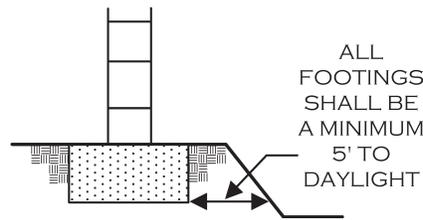



TABLE "A"			TABLE "B"		
"H"	"W"	VERTICAL REINF. #4 STEEL BARS	"H"	"W"	VERTICAL REINF. #4 STEEL BARS
3'	12"	48" O.C.	3'	12"	48" O.C.
4'	18"	48" O.C.	4'	18"	48" O.C.
5'	18"	24" O.C.	5'	24"	24" O.C.
6'	18"	24" O.C.	6'	26"	24" O.C.

Block Wall Inspections Required:

1. SURVEYORS MARKERS (stakes/markers shall be left in place for footing inspection)
2. FOOTINGS AND STEEL/REBAR (horizontal footing rebar and vertical wall rebar extending from footings shall be in place)
3. GROUT LIFT
4. FINAL GROUT LIFT (after all blocks in place; vertical and top horizontal rebar inspection)
5. FINAL (wall complete)

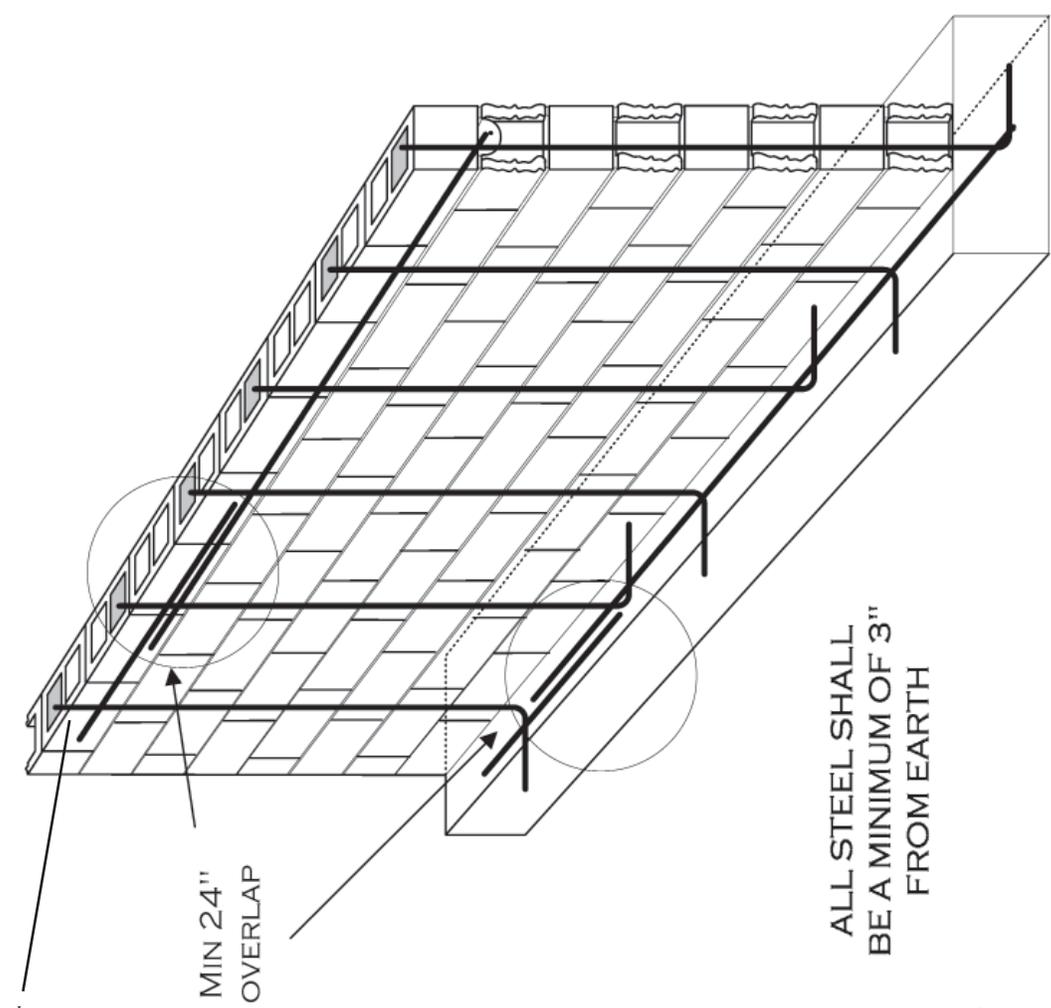

FOOTING OPTION A

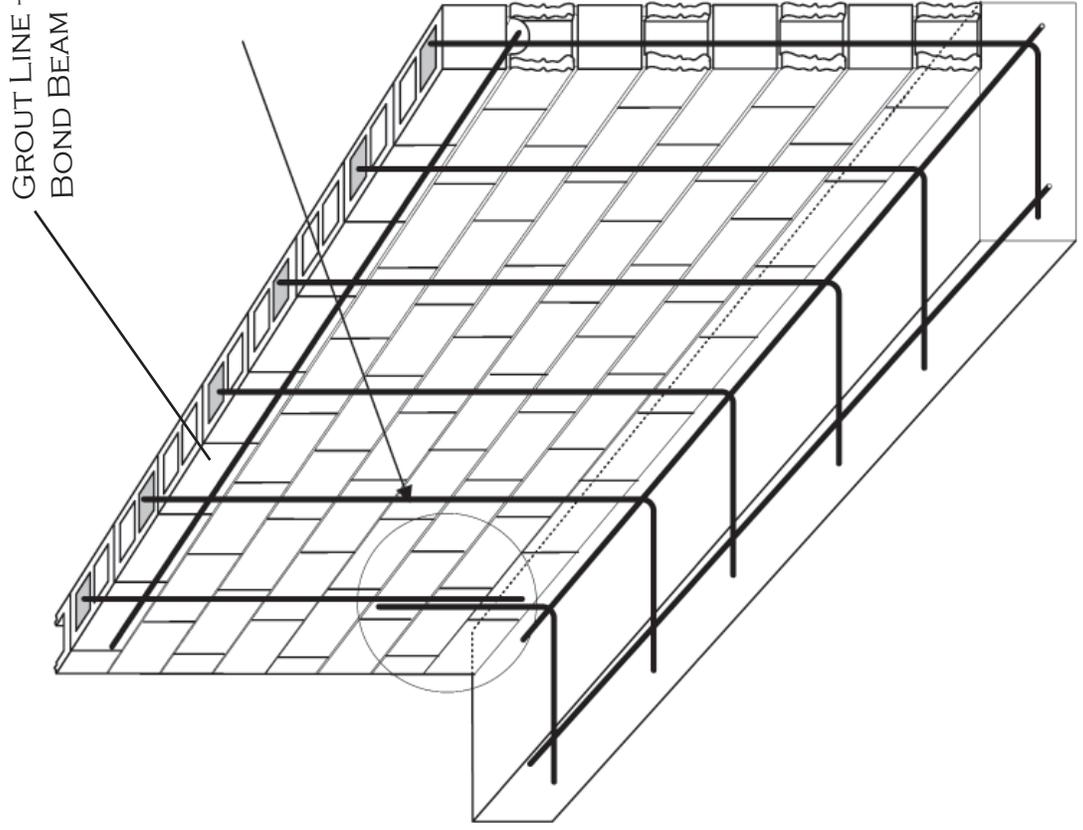

FOOTING OPTION B